

Mr Douglas A J Stewart

Kirkburn Laboratory
 Kirkburn Industrial Estate
 Lockerbie
 Dumfries and Galloway DG11 2SE
 01576710288

GRADATION ANALYSIS TEST REPORT
for Product: GQ100052A/ Recycled 10/20
Supplier/ source: Kelhead Recycling

Material type: Drystone aggregate Test method: Dry grading to BS EN 933-1

SAMPLE INFORMATION

Sampled/ tested
 Mon 14 September 2015/ 18-09-15
 at 1618 hrs

Sample number 18088

Customer	In House	Site	Kelhead Recycling Station
Truck No	-	Ticket No	-
Sampling Notes	-	Aggregate type	-
Weather	-	Sampled By	rd


SAMPLE ANALYSIS

Sieve size	Percent passing	Specification limits	Complies ?
40mm	100	100 - 100	yes
31.5mm	100	98 - 100	yes
20mm	91	85 - 99	yes
16mm	65	-	-
14mm	49	-	-
10mm	12	0 - 20	yes
6.3mm	0	-	-
4mm	0	0 - 5	yes
0.063mm	0	0 - 4	yes
Moisture content %	1.7	not specified	-

Parameters are evaluated to the accuracy of spec. limits

REMARKS

Compliance status ok
Category A of A-C excludes secondary parameters

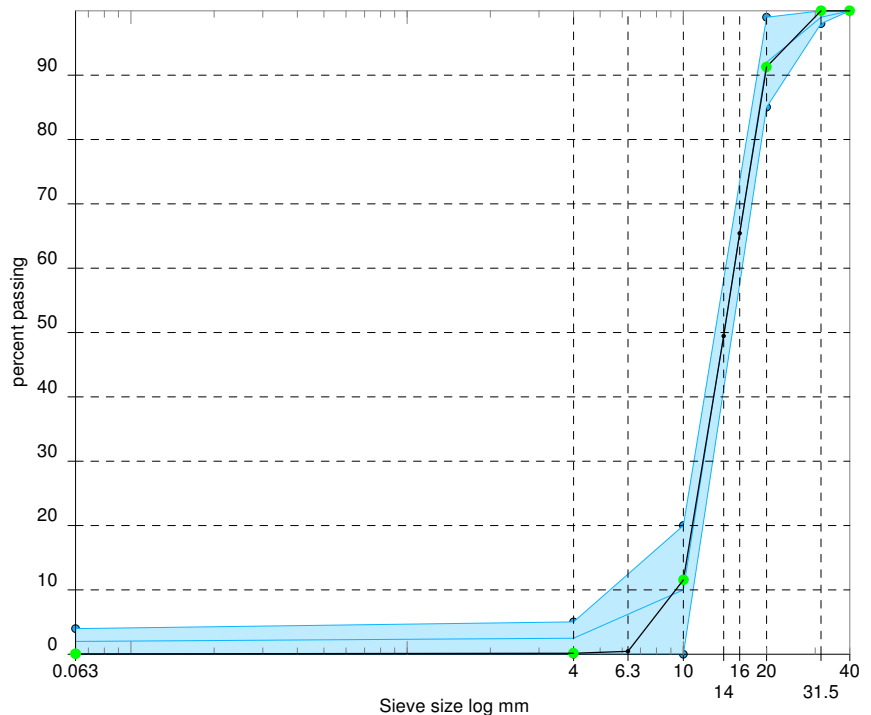

Signed _____ for Grange Quarry Date ___/___/2015